

Current water bill: The enclosed bill for water service covers service in July and August, prior to the Caldor Fire. All customers were charged the basic monthly rate of \$68.97. We did not bill for any usage due to the fire damage to many meters in our system.

Future water bills: We are working with a consultant who will examine our current water rates, cost of service and policies/procedures and make recommendations on how best to move forward. Watch for the item to be discussed at future board meetings.

Water Emergency Line: If you need to report a leak or another urgent issue with your water service **after office hours or on weekends**, please call our emergency line at **(530) 497-4666**. Please be sure to provide your name, phone number and description of the issue.

Potable Water Restoration Map (on Reverse Side)

Some areas of our water system have had water use restrictions lifted. The attached map was current as of October 19, 2021 but be sure to check often for updates!

For the most up-to-date information:

Visit our website's "Caldor Recovery" page: http://grizzlyflatscsd.com/?page_id=2280

Check our Facebook page: (<https://www.facebook.com/grizzlyflatswater/>)

"Potable" – all areas marked as "potable" have had water use restrictions lifted. You may use your water for drinking, cooking, showering, laundry, etc. Before an area is declared "potable", all water quality testing must be completed, and results must show water meets or exceeds all standards set by the State's Division of Drinking Water (DDW). Test results are reviewed by the District's Engineers, Water System Operators and DDW. Restrictions are lifted once both agencies are satisfied that the water being delivered is safe and free of contaminants.

"Public Notification Remains in Place" – areas marked with "Public Notification Remains in Place" are still under the DO NOT DRINK – DO NOT USE order. The State Water Resources Control Board, El Dorado County Environmental Management Department, and Grizzly Flats Community Services District Water System advise residents in these areas to **NOT USE THE TAP WATER for anything other than flushing toilets and watering plants** until water quality testing is completed and the area has been declared "potable" by GFCSD.


Bottled water is available! The Grizzly Flats Community Services District is distributing an emergency supply of 1-gallon jugs of bottled water for residents at the District office (4765 Sciaroni Road, Grizzly Flats) Monday through Friday, from 8:00 AM to 4:00 PM.

Residents should expect intermittent interruptions to their water service as we continue with repairs to the water system from damage sustained during the Caldor Fire. A loss of pressure or loss of water may occur without warning due to system flushing or an emergency line repair.

This notice is being sent to you by Grizzly Flats Community Services District. California Public Water System ID # CA0910006. Date Distributed: October 20, 2021.

GRIZZLY FLAT COMMUNITY SERVICES DISTRICT WATER NETWORK

Caldor Fire - Water Quality Sampling Locations and Areas

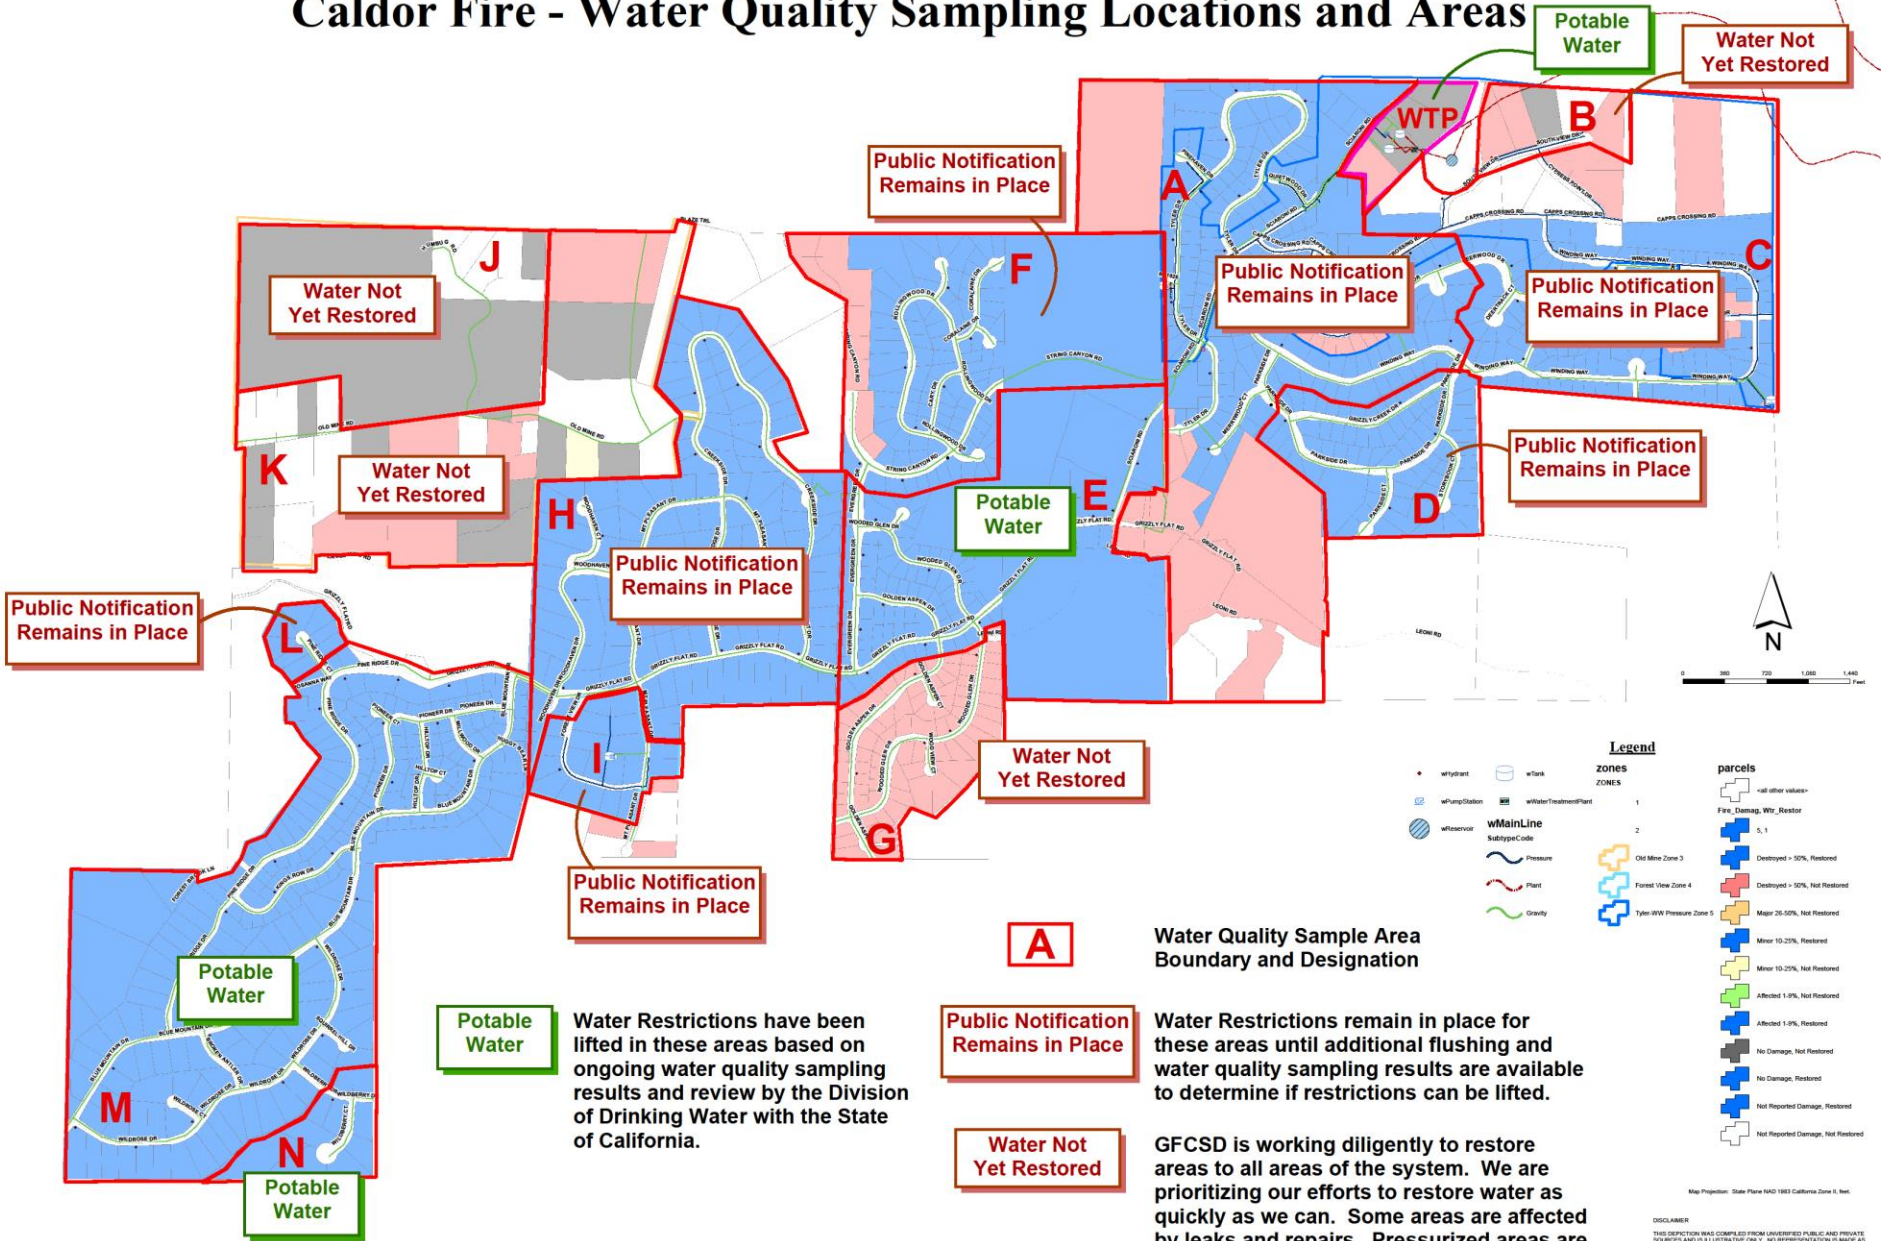

A

Water Quality Sample Area Boundary and Designation

Public Notification Remains in Place


Water Restrictions remain in place for these areas until additional flushing and water quality sampling results are available to determine if restrictions can be lifted.

Water Not Yet Restored

GFCSD is working diligently to restore areas to all areas of the system. We are prioritizing our efforts to restore water as quickly as we can. Some areas are affected by leaks and repairs. Pressurized areas are affected by more significant repairs and replacement of pumps and equipment.

Legend

<ul style="list-style-type: none"> wHydant wPumpStation wReservoir wMainLine SubtypeCode Pressure Plant Gravity 	<ul style="list-style-type: none"> wWaterTreatmentPlant 	<p>zones</p> <p>1</p> <p>2</p> <p>Old Mine Zone 3</p> <p>Forest View Zone 4</p> <p>Tyler WW Pressure Zone 5</p>	<p>parcels</p> <ul style="list-style-type: none"> -all other values- Fire_Damaged_Wtr_Restored 5, 1 Destroyed > 50%, Restored Destroyed > 50%, Not Restored Major 25-50%, Not Restored Minor 10-25%, Restored Minor 10-25%, Not Restored Affected 1-9%, Not Restored Affected 1-9%, Restored No Damage, Not Restored No Damage, Restored Not Reported Damage, Restored Not Reported Damage, Not Restored
--	--	--	---



Map Projection: State Plane NAD 1983 California Zone 1, feet.

DISCLAIMER
THIS DEPICTION WAS COMPILED FROM UNVERIFIED PUBLIC AND PRIVATE SOURCES AND IS ILLUSTRATIVE ONLY. NO REPRESENTATION IS MADE AS TO ACCURACY OF THAT INFORMATION AND NONE MAY BE INFERRED THEREFROM. LEGAL MAPS USE TO THAT INFORMATION AT THEIR OWN RISK.

NOTES:
LAYER INFORMATION MAY COVER ADDITIONAL AREAS OUTSIDE OF THE DISPLAYED AREA.
MAP PREPARED BY: SCOTT MYERS DATE: 8/22/2017
GIS BASE MAP DATA PROVIDED BY: EL DORADO COUNTY SURVEYORS & DIVISION
G.I.S. PROJECT ID: 4539 - RELIABILITY REPORT - RD